

TeraPrint Produktunterlage

Gebrandete TeraPrint-Downloadunterlage

PRODUKT	Bodenschutz
UNTERLAGE	SBI Bericht
TYP	fire_certificate
ORIGINALSEITEN	1
STAND	16.06.2026
DATEI	products/recruiting-sign/assets/documents/a0fcc532944f5a17dc6ff7c2bb3fd1c1bac1de34ed2e0a6f004e5bc817e71ade.pdf

Wichtig fuer die Produktion

Die folgenden Originalseiten bleiben in Format, Reihenfolge und Inhalt unveraendert.
Druckmass, Schnitt, Beschnitt, Sicherheitsbereiche und technische Vorlage wurden nicht veraendert.
Bei Zertifikaten, Datenblaettern und Pruefberichten bleiben Aussteller und Originalinhalte unveraendert.

TeraPrint Hinweis

Diese Datei ist lokal bei TeraPrint gespeichert und fuer den Kunden-Download vorbereitet.
Bitte bei Druckdaten immer die Massangaben und Beschnitt-/Sicherheitszonen der Originalvorlage beachten.
Bei Unsicherheit vor Bestellung oder Produktion TeraPrint kontaktieren.

Construction products

General information

Date of test 04/05/2023
Report identification number/file ENL-23-000014_1.xls
Operator LEG

Specimen

Sponsor Sign Again
Description Sign Again

Standard used EN 13823:2020

Fire attack

Start of test [s] 300
Burner exposure time [s] 1200
Burner exposure level [kW] 31,6 Std 0,28

Results

Heat release related

		t-t0 [s]	t[s]
Peak HRRav (t<t0+600s)	[kW]	63,7	201
Peak HRRav (t<t0+900s)	[kW]	63,7	201
Peak HRRav (t<t0+1200s)	[kW]	63,7	201
(t0 = 300s)			

Figra0.2 MJ	[W/s]	355	
Figra0.4 MJ	[W/s]	355	D
Figra	[W/s]	355	D
Figra0.2 MJ: Corresponding HRRav	[kW]	51,2	144
Figra0.4 MJ: Corresponding HRRav	[kW]	51,2	144
t(HRRav >= 3 kW)		30	330
(HRRav + t(THRta)) >= 0.2 MJ	[kW]	11,78	54
(HRRav + t(THRta)) >= 0.4 MJ	[kW]	17,7	69

THRta (t0+600s)	[MJ]	18,77	D or worse
THRta (t0+900s)	[MJ]	21,6	
THRta (t0+1200s)	[MJ]	23,3	
(t0 = 300s)			
		Estimated class:	D or worse

Lateral flame spread

Till long wing end of specimen No No = not to long wing end of specimen
Estimated class: D or worse

Smoke production related

		t-t0 (s)	t(s)
Peak SPRav (t<t0+600s)	[m²/s]	4,77	144
Peak SPRav (t<t0+900s)	[m²/s]	4,77	144
Peak SPRav (t<t0+1200s)	[m²/s]	4,77	144
(t0 = 300s)			

Smogra max	[m²/s²]	389,9	s3
at SPRav	[m²/s]	3,98	102
t(SPRav >= 0.1 m²/s)		21	321
t(TSPta >= 6 m²)		42	342





TSPta (t0_t0+600s)	[m²]	1208	s3
TSPta (t0_t0+900s)	[m²]	1296	
TSPta (t0_t0+1200s)	[m²]	1337	
(t0 = 300s)			
		Estimated class:	s3

Flaming droplets/particles related

Flaming droplets/particles

FDP (t0_t0+600s) Yes No = no flaming droplets/particles
FDP (t0_t0+600s) F>10s Yes No = no flaming droplets/particles F>10s
(not d0 or d1)

Estimated class: d2

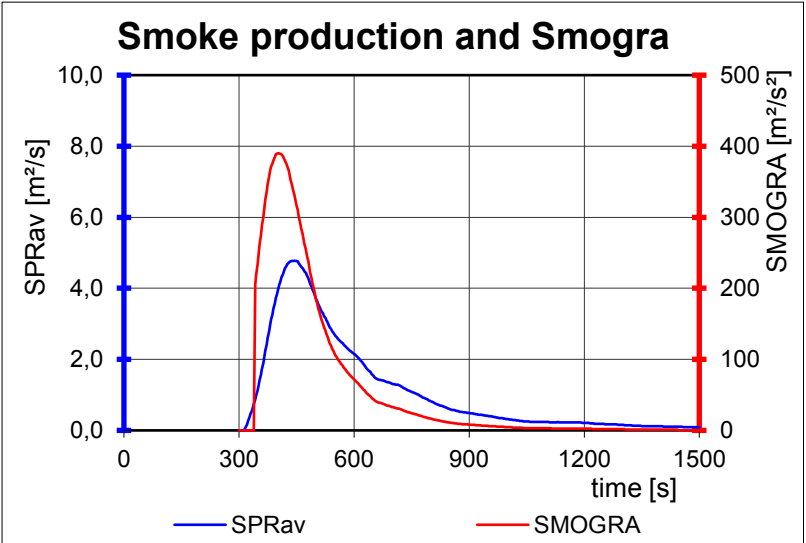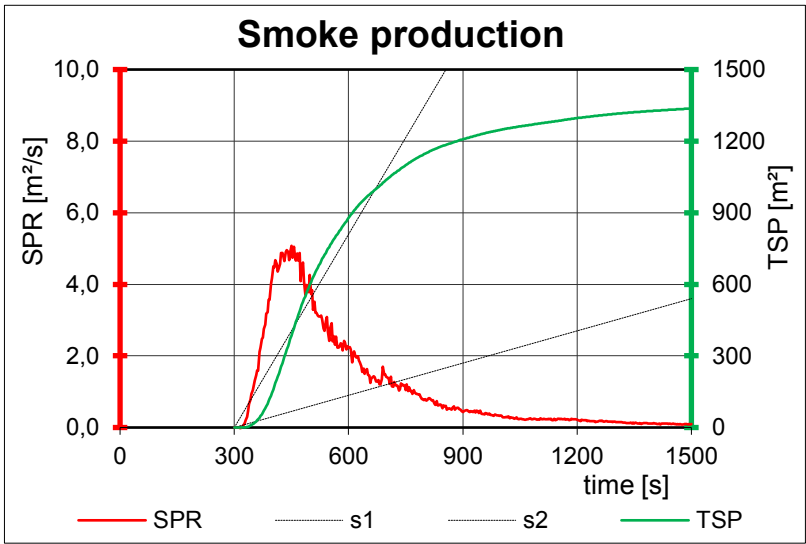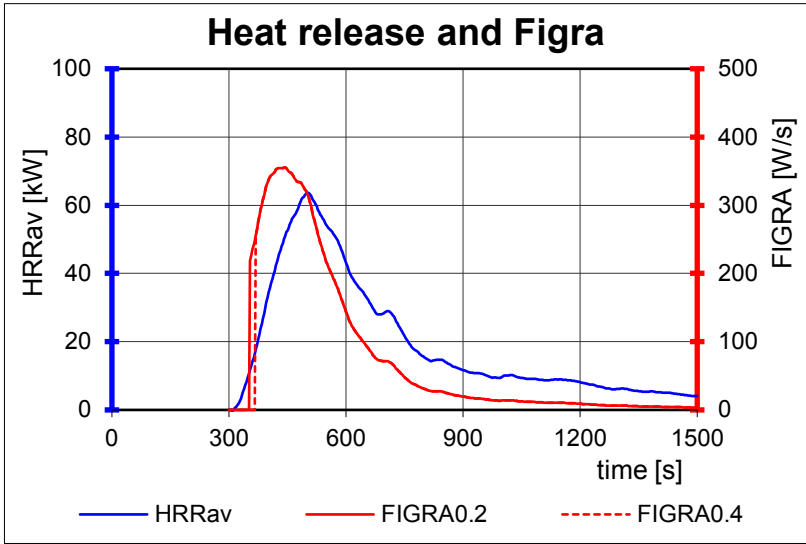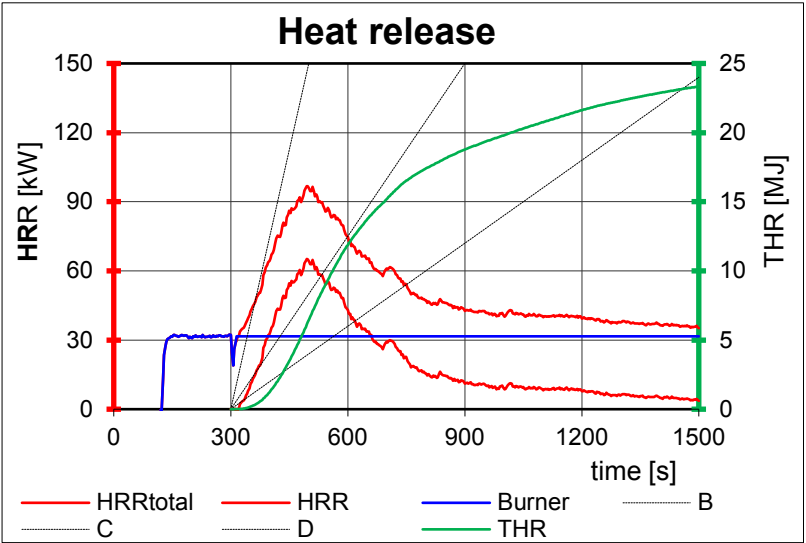

Classification criteria	A1*	A2-B	C	D
FIGRA _{0,2MJ}	[W/s] <= 20	120		
FIGRA _{0,4MJ}	[W/s] <=		250	750
THR _{600s}	[kW] <= 4	7,5	15	
	s1, d0	s1	s2	s3
SMOGRA	[m²/s²] <=	30	180	not s1/s2
TSP _{600s}	[m²] <=	50	200	not s1/s2

* External non-substantial component having PCS > 2,0 MJ/kg and a PCS ≤ 2,0 MJ/m²

Final classification assessment is based on 3 repetitive SBI tests and other tests:
- A1: EN ISO 1182 or EN ISO 1716
- A2: EN ISO 1182 or EN ISO 1716
- B, C, D: EN ISO 11925-2